

OIL-WET INCLINING PLATFORM SLIP RESISTANCE TEST

Taralay Initial Comfort Vinyl

Prepared for: Bronwyn Campbell
 Gerflor Australasia Pty Ltd
 17 Cato Street
 HAWTHORN EAST VIC 3123

Specimen Description: Taralay Initial Comfort Vinyl, 1000x1000 mm.

No. of Specimens: 1 off

Surface Structure: Smooth

Specimen Preparation: Washed with water and pH neutral detergent, rinsed then dried.

Specimen Configuration: Fixed

Test Direction: Test direction not applicable.

Joint Type & Width: N/A

Air Temperature: 21°C

Test Standard: AS 4586:2013 Slip resistance classification of new pedestrian surface materials, Appendix D - Oil Wet Inclining Platform Test

Test Shoe: Leipzig V73-SP

Test Location: ATTAR, Unit 1, 64 Bridge Road, Keysborough.

Test Date: 12 October 2017

Test Personnel: David Padfield and Suzanne Andrews

Displacement Space (rounded to the nearest 0.5cm ³ /dm ²):	Not tested
Displacement Space Assessment Group (Appendix E, AS 4586 - 2013):	Not tested
Corrected mean overall acceptance angle (α_{ave}) (rounded down to the nearest degree):	10°
Classification:	R10

These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance procedures and wear on their slip resistance be checked.

Reviewed By:



Suzanne Andrews
Compliance and Test Technician



David Padfield BEng(mat) Hons., MIEAust,
Senior Materials and Testing Engineer
Approved Signatory

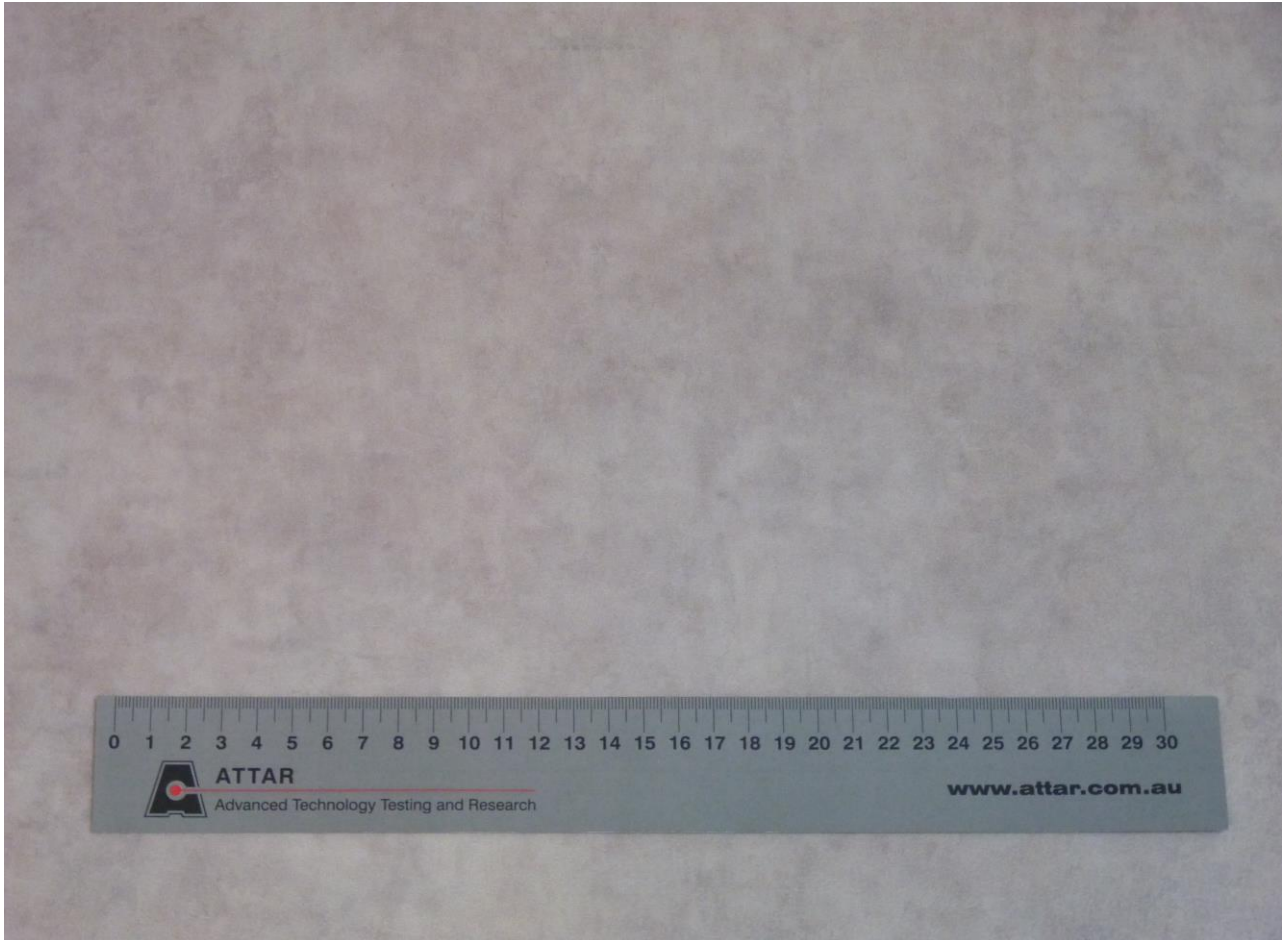


Figure 1: Taralay Initial Comfort Vinyl



CLASSIFICATION CRITERIA – AS 4586 - 2013
Oil Wet Inclining Platform Test – Appendix D

Compliance

TABLE 5: CLASSIFICATION OF PEDESTRIAN SURFACE MATERIALS ACCORDING TO THE OIL-WET INCLINING PLATFORM TEST

Classification	Angle, degrees
No Classification	<6
R9	≥6 <10
R10	≥10 <19
R11	≥19 <27
R12	≥27 <35
R13	≥35